


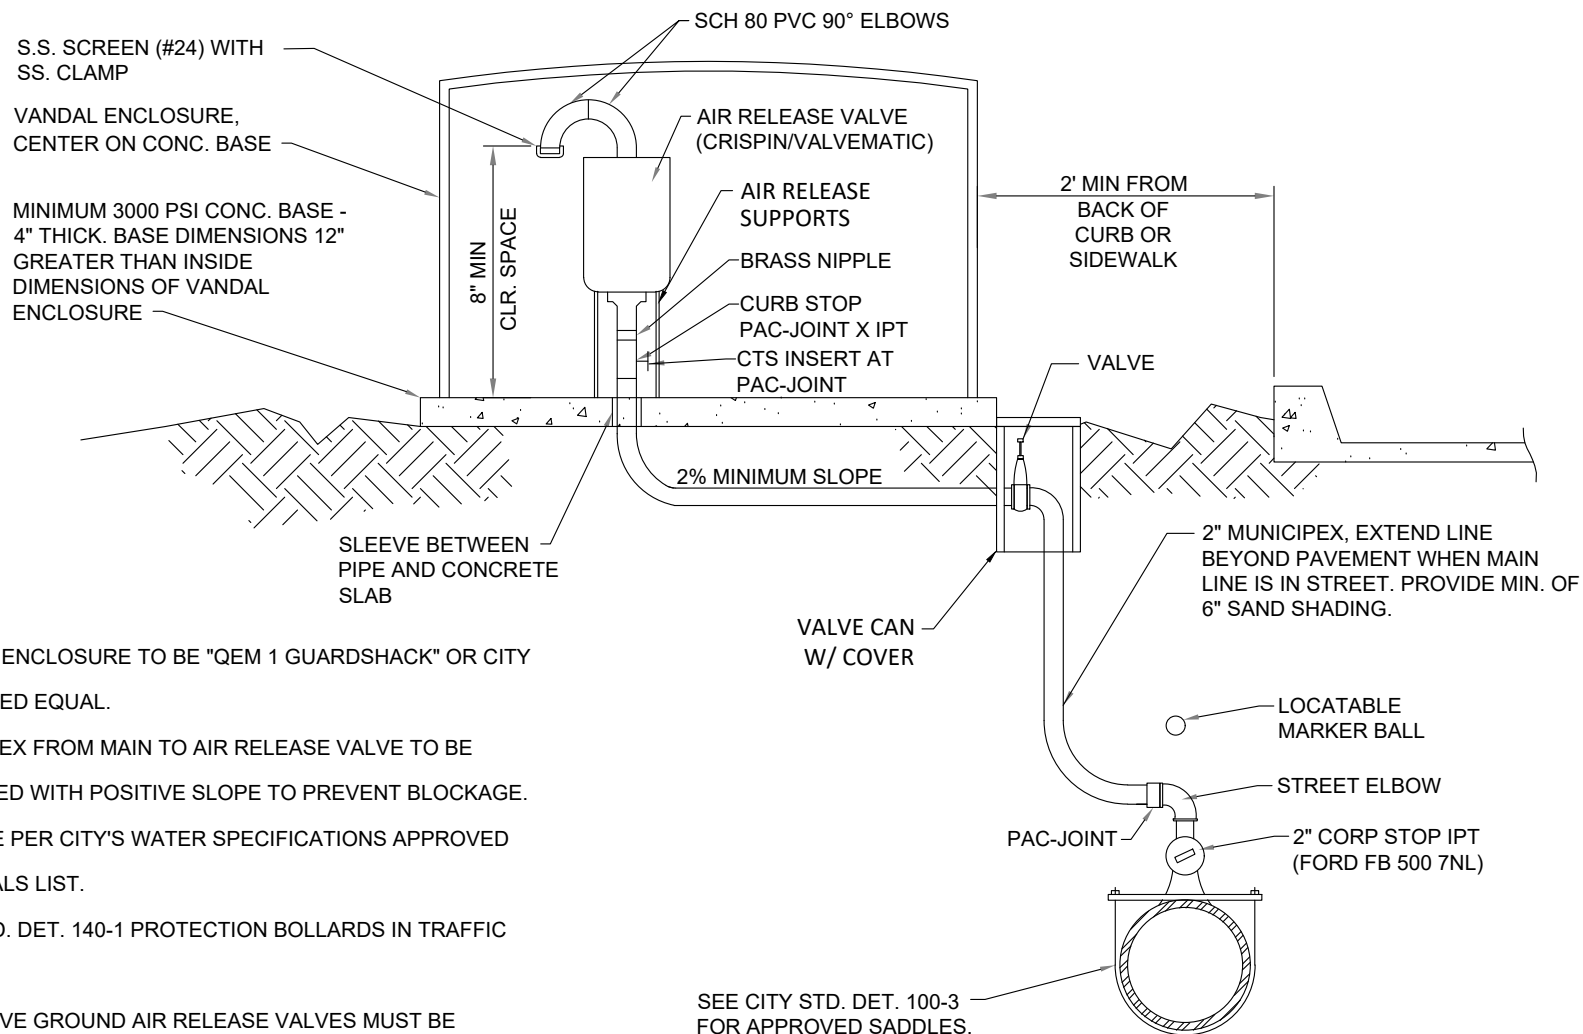

NOTES:

1. VANDAL ENCLOSURE TO BE "QEM 1 GUARDSHACK" OR CITY APPROVED EQUAL.
2. MUNICIPEX FROM MAIN TO AIR RELEASE VALVE TO BE INSTALLED WITH POSITIVE SLOPE TO PREVENT BLOCKAGE.
3. PROVIDE PER CITY'S WATER SPECIFICATIONS APPROVED MATERIALS LIST.
4. MAG STD. DET. 140-1 PROTECTION BOLLARDS IN TRAFFIC AREAS.
5. ALL ABOVE GROUND AIR RELEASE VALVES MUST BE PRE-APPROVED BY CITY. UNDERGROUND AIR RELEASE VALVES PER CITY'S STD. DET. 351-3.
6. CONCRETE METER BOX PER MAG STD DET 320 BOX NO. 2 W/ STEEL LID.
7. PIPE FITTINGS AND APPURTENANCES TO MATCH AIR RELEASE SIZE.

SEE CITY STD. DET. 100-3
FOR APPROVED SADDLES.

Date:
November 2022



2355 Trane Rd.
Bullhead City, AZ. 86442
(928) 763-9400

POTABLE AIR RELEASE VALVE

Detail No.
351-1