



STANDARD

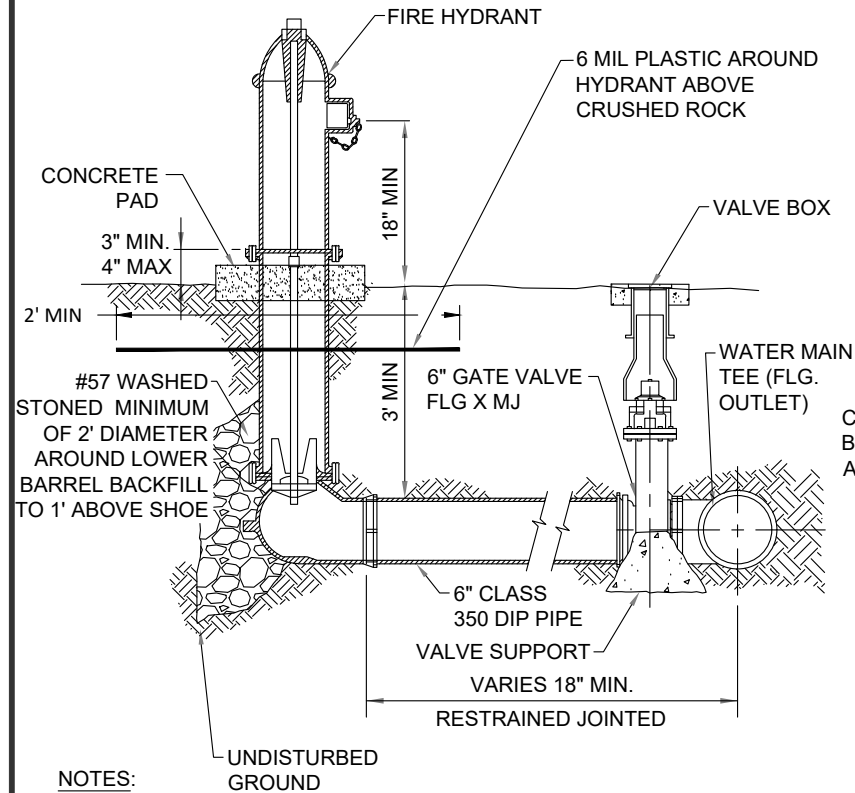

NOTES:

1. SEE CITY STD. DET. 100-1 FOR FIRE HYDRANT GENERAL NOTES.
2. ALL JOINT RESTRAINTS PER M.A.G. STD. DET. 303- 1 & 2 AND M.A.G. SECT. 750.3.
3. VALVE BOX PER M.A.G. STD. DET. 391-1-C.
4. ALL VALVE OPERATING NUTS SHALL BE A MAX OF 36 INCHES BELOW GROUND.
5. DRY BARREL HYDRANTS SHALL BE MUELLER "SUPER CENTURION 350", CLOW "MEDALLION", WITH NATIONAL STANDARD HOSE THREADS. NO APPROVED EQUALS WILL BE ACCEPTED. MUST BE 5-1/4" MAIN VALVE OPENING
6. PROVIDED A MINIMUM 3 FOOT DIAMETER CLEARANCE AROUND HYDRANT.

DEEP

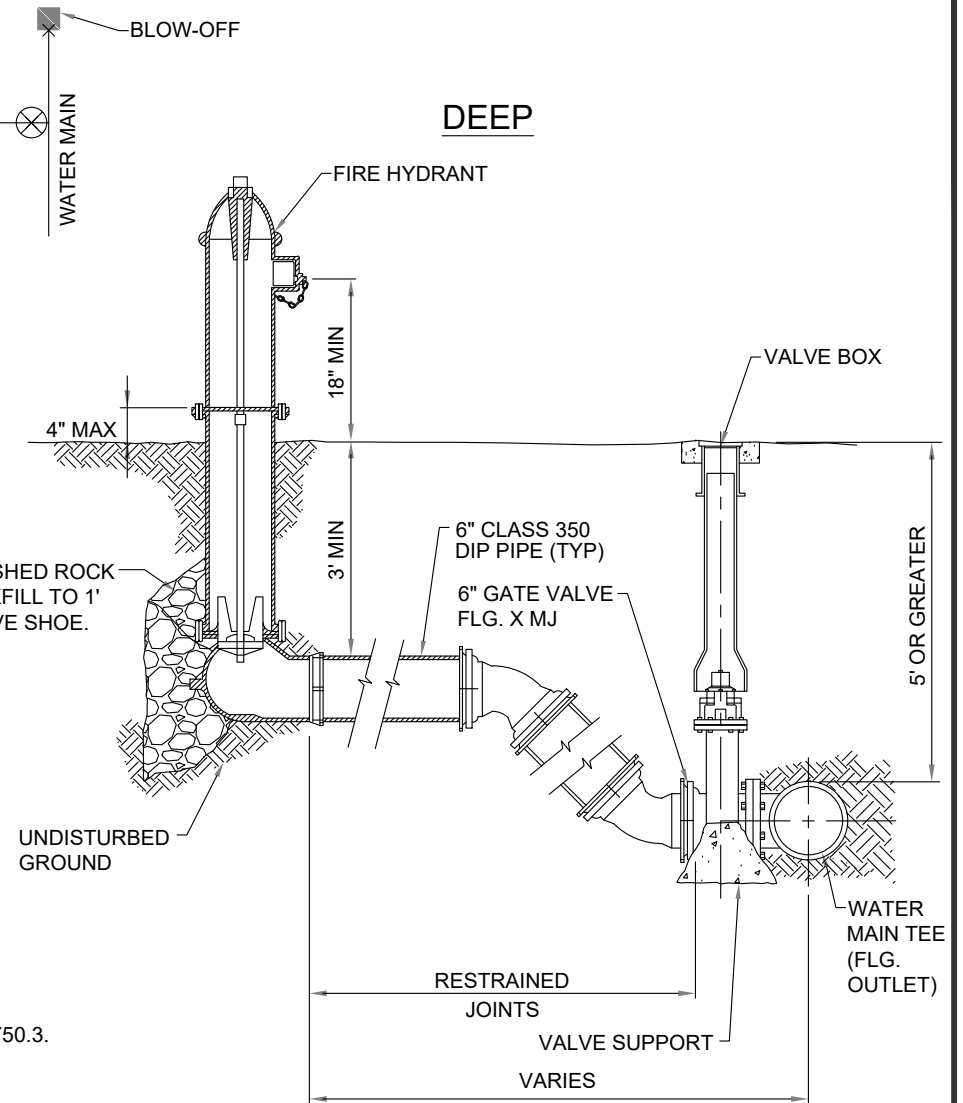

Date:
November 2022



2355 Trane Rd.
Bullhead City, AZ. 86442
(928) 763-9400

DRY BARREL FIRE HYDRANT INSTALLATION

Detail No.
360-1